


DRIP PAN ELBOW

SPECIFICATION

The Drip Pan Elbow shall be a minimum of the size of the safety valve discharge and installed on the discharge side of the safety valve. It shall be made of cast iron and conform to the Power Piping Code. It shall have a pan to collect condensate in the steam riser pipe and a drain to pipe away the condensate.

MATERIALS OF CONSTRUCTION

BodyCast Iron
ASTM A126 Class B

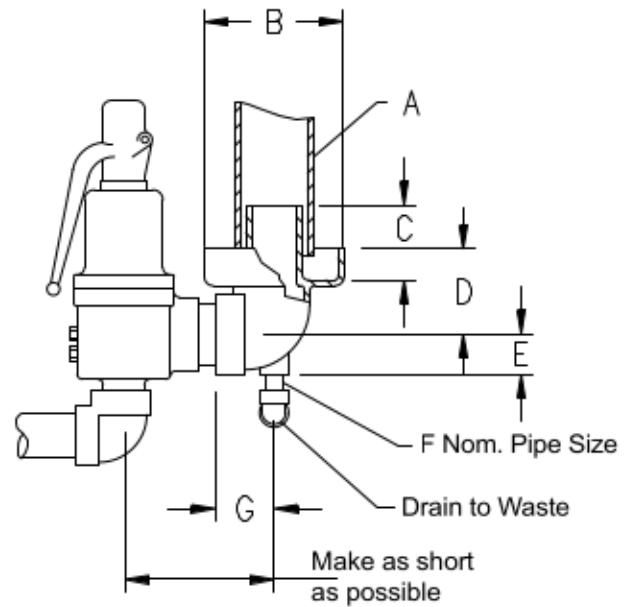

DIMENSIONS* inches (mm) AND WEIGHTS pounds (kg)

Model	Outlet	A	B	C	D	E	F	G	Weight
DPE-D	$\frac{3}{4}$	2 (51)	$3\frac{3}{4}$ (95)	$2\frac{1}{2}$ (70)	2 (51)	1 (25)	$\frac{3}{8}$ (10)	$1\frac{1}{2}$ (38)	2 (.9)
DPE-E	1	2 (51)	$3\frac{3}{4}$ (95)	$2\frac{1}{2}$ (70)	2 (51)	1 (25)	$\frac{3}{8}$ (10)	$1\frac{1}{2}$ (38)	2 (.9)
DPE-F	$1\frac{1}{4}$	2.5 (65)	$5\frac{1}{2}$ (140)	$4\frac{1}{8}$ (125)	$4\frac{1}{4}$ (105)	$1\frac{1}{8}$ (37)	$\frac{3}{8}$ (10)	$2\frac{1}{2}$ (54)	4 (1.8)
DPE-G	$1\frac{1}{2}$	2.5 (65)	$5\frac{1}{2}$ (140)	$4\frac{1}{8}$ (125)	$4\frac{1}{4}$ (105)	$1\frac{1}{8}$ (37)	$\frac{3}{8}$ (10)	$2\frac{1}{2}$ (54)	4 (1.8)
DPE-H	2	3 (76)	$6\frac{1}{4}$ (159)	$4\frac{3}{8}$ (117)	$3\frac{3}{8}$ (92)	$1\frac{1}{8}$ (41)	$\frac{1}{2}$ (13)	$2\frac{1}{2}$ (57)	6 (2.7)
DPE-J	$2\frac{1}{2}$	4 (102)	$7\frac{1}{2}$ (187)	$5\frac{1}{8}$ (141)	$4\frac{3}{8}$ (110)	$1\frac{1}{8}$ (49)	$\frac{3}{8}$ (19)	$2\frac{1}{8}$ (68)	11 (5.0)
DPE-K	3	4 (102)	8 (203)	$6\frac{1}{2}$ (165)	$4\frac{1}{4}$ (124)	$2\frac{5}{8}$ (59)	$\frac{3}{8}$ (19)	$3\frac{3}{8}$ (79)	14 (6.4)
DPE-M	4	6 (152)	$9\frac{3}{4}$ (244)	$8\frac{1}{4}$ (210)	$5\frac{3}{8}$ (146)	$2\frac{1}{2}$ (73)	$\frac{3}{8}$ (19)	$3\frac{3}{8}$ (95)	26 (11.8)
DPE-P*	6	8 (203)	$12\frac{1}{4}$ (324)	$11\frac{1}{8}$ (294)	$7\frac{3}{8}$ (192)	$4\frac{3}{8}$ (106)	$\frac{3}{8}$ (19)	8 (203)	74 (33.6)
DPE-Q*	8	10 (254)	$16\frac{1}{2}$ (419)	$14\frac{1}{4}$ (378)	$9\frac{3}{8}$ (243)	$5\frac{1}{2}$ (146)	1 (25)	$10\frac{3}{8}$ (273)	100 (45.4)

*6" and 8" Drip Pan Elbows have integral 125# flange.